



**EXAMPLE 2:
INSULATION BELOW SLAB & SLAB EDGE INSULATION
ON INTERIOR OF FROST WALL FOR A TOTAL OF 48"
& A TOTAL R-VALUE OF 15**

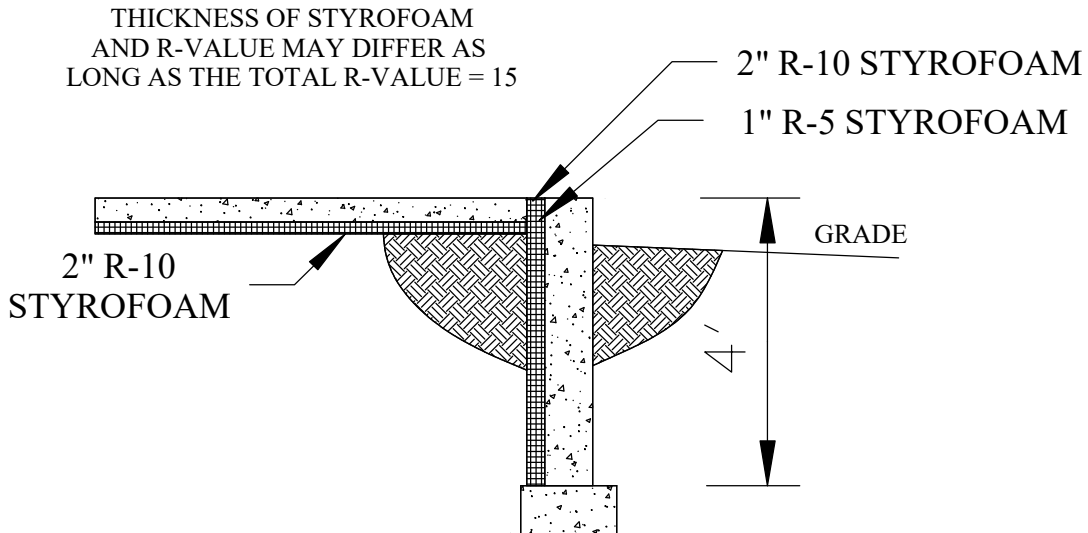


THI
AND
LONG /
THE R-
ON EITI

**EXAMPLE 3:
INSULATION BELOW SLAB & SLAB EDGE INSULATION
ON THE EXTERIOR & INTERIOR FOR A TOTAL OF 48"
& A TOTAL R-VALUE OF 15**


THICKNESS OF STYROFOAM
AND R-VALUE MAY DIFFER AS
LONG AS THE TOTAL R-VALUE = 15

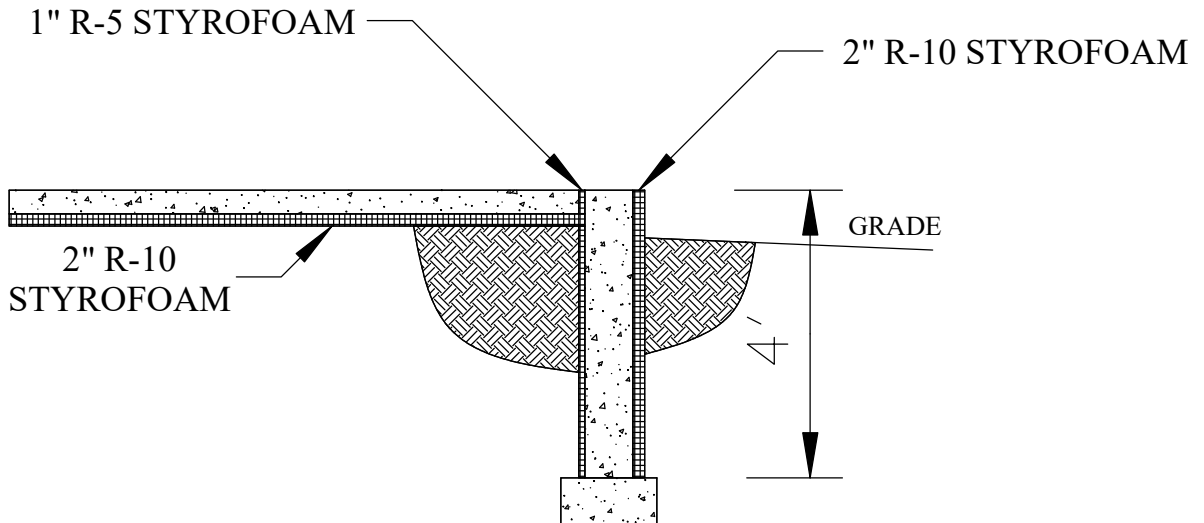


**EXAMPLE 4:
INSULATION BELOW SLAB & ALL SLAB EDGE INSULATION
ON INTERIOR OF FROST WALL EXTENDING DOWN &
HORIZONTALLY FOR A TOTAL OF 48"
& A TOTAL R-VALUE OF 15**

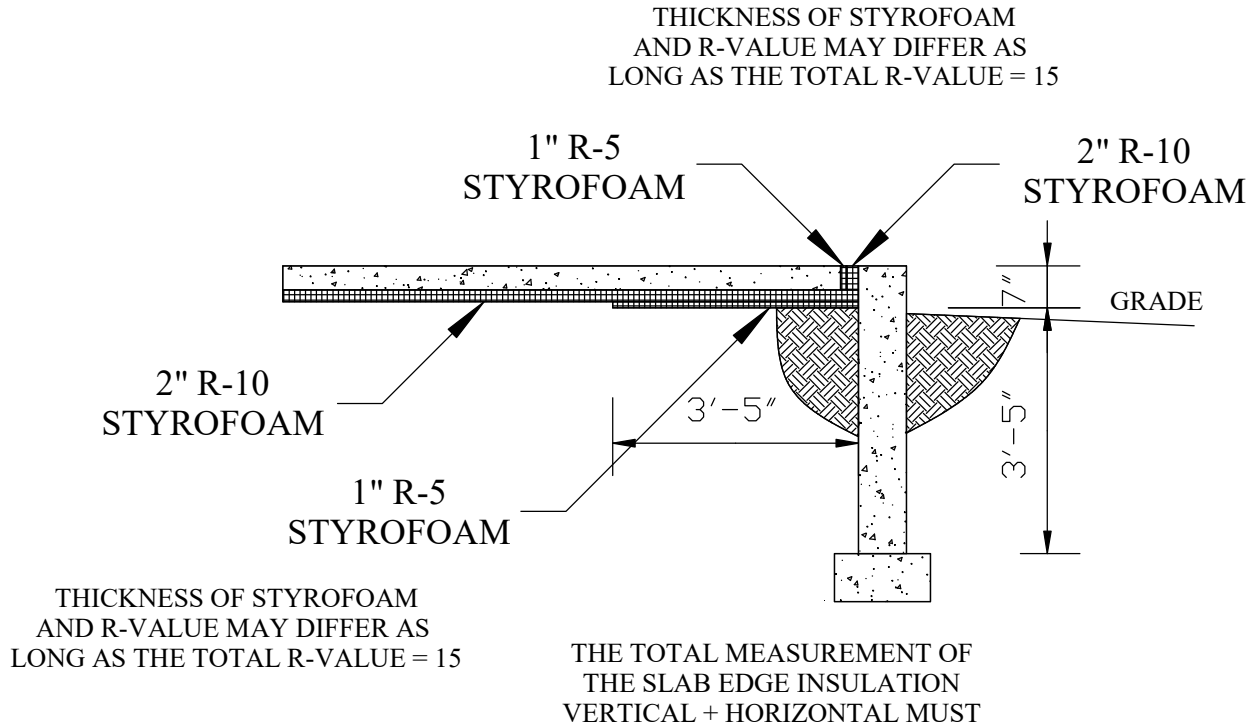

**EXAMPLE 5:
INSULATION BELOW SLAB & SLAB EDGE INSULATION
ON EXTERIOR EXTENDING DOWN & OUT HORIZONTALLY
FOR 48" & A TOTAL R-VALUE OF 15**

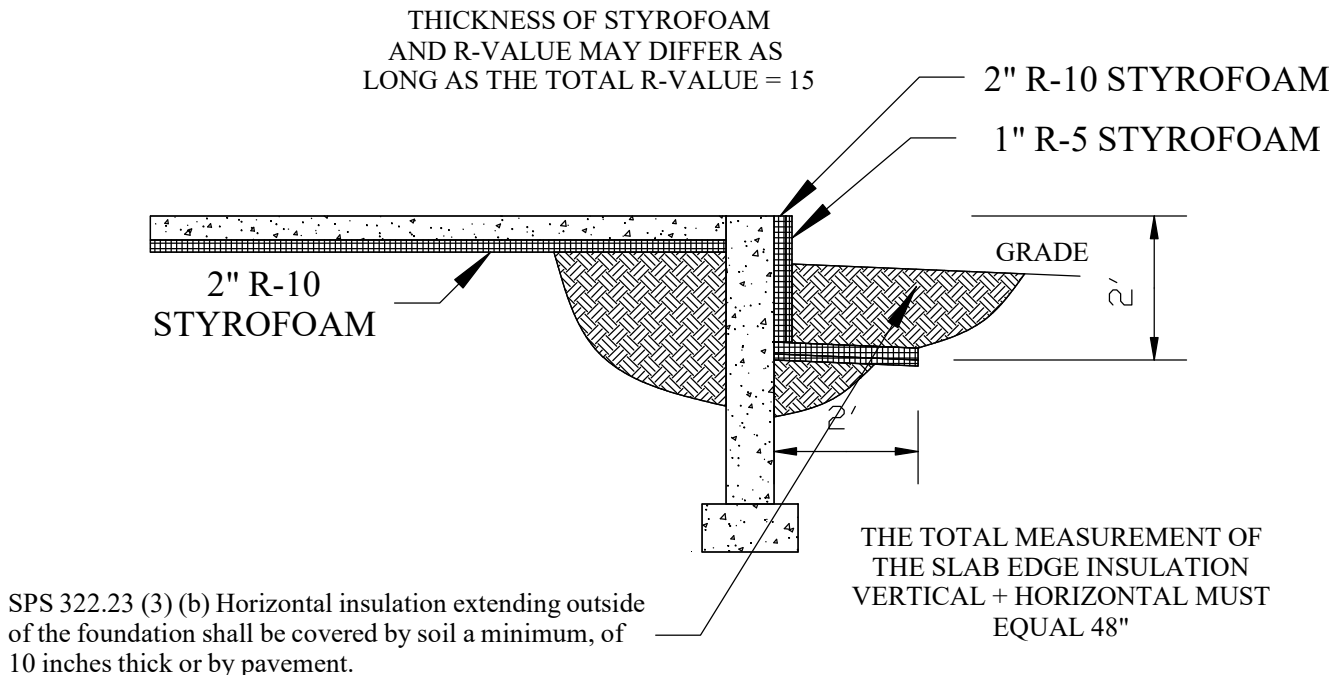


**EXAMPLE 6:
INSULATION BELOW SLAB, SLAB OVER FROST WALL & ALL SLAB
EDGE INSULATION ON EXTERIOR OF FROST WALL FOR A TOTAL OF 48"
& A TOTAL R-VALUE OF 15**

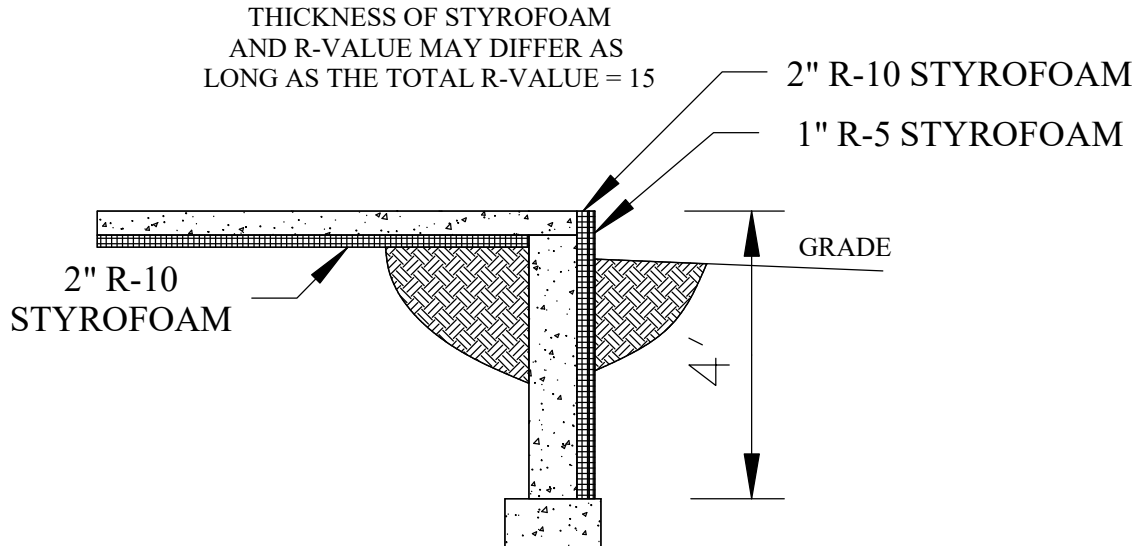

**EXAMPLE 7:
INSULATION BELOW SLAB & SLAB EDGE INSULATION
ON EXTERIOR OF FROST WALL & INTERIOR OF SLAB EDGE
& INTERIOR OF FROST WALL WITH FROST WALL
NOTCHED FOR FLOOR**

THICKNESS OF STYROFOAM
AND R-VALUE MAY DIFFER AS
LONG AS THE TOTAL R-VALUE = 15
THE R-5 AND R-10 MAY BE PLACED
ON EITHER THE INSIDE OR OUTSIDE


**THIS METHOD REQUIRES A
MINIMUM 10" THICK WALL &
A MINIMUM 18" WIDE FOOTING
TO COMPLY W/SPS 321.18 (2) (A)
& SPS 321.15 (2) (a).**

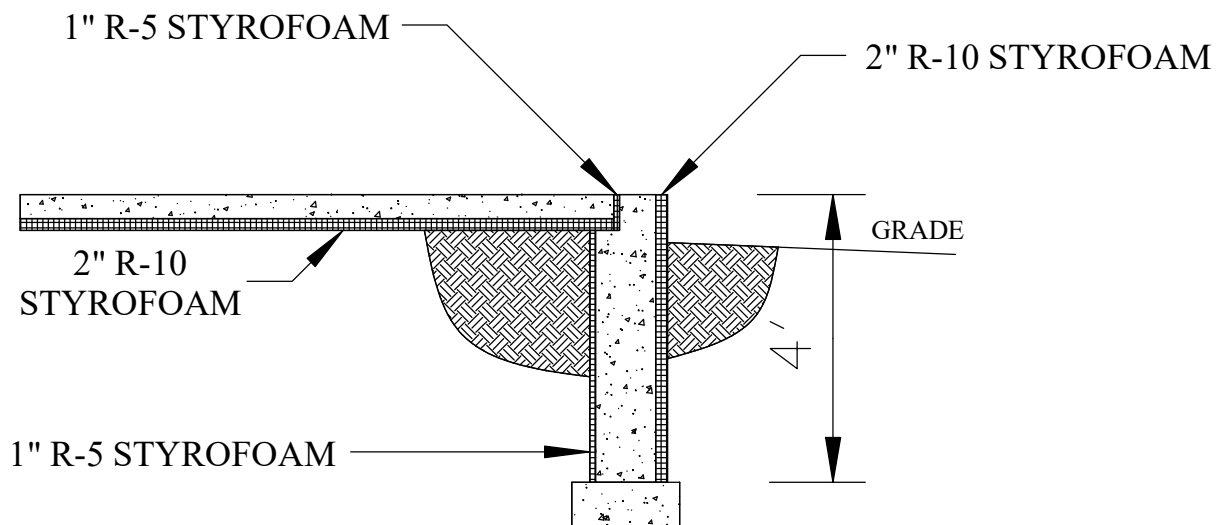


**EXAMPLE 8:
INSULATION BELOW SLAB & SLAB EDGE INSULATION
ON EXTERIOR OF FROST WALL FOR A TOTAL OF 48"
& TOTAL R-VALUE OF 15 WITH FLOOR NOTCHED INTO
FROST WALL**

THICKNESS OF STYROFOAM
AND R-VALUE MAY DIFFER AS
LONG AS THE TOTAL R-VALUE = 15

THIS METHOD REQUIRES A
MINIMUM 10" THICK WALL &
A MINIMUM 18" WIDE FOOTING
TO COMPLY W/SPS 321.18 (2) (A)
& SPS 321.15 (2) (a).

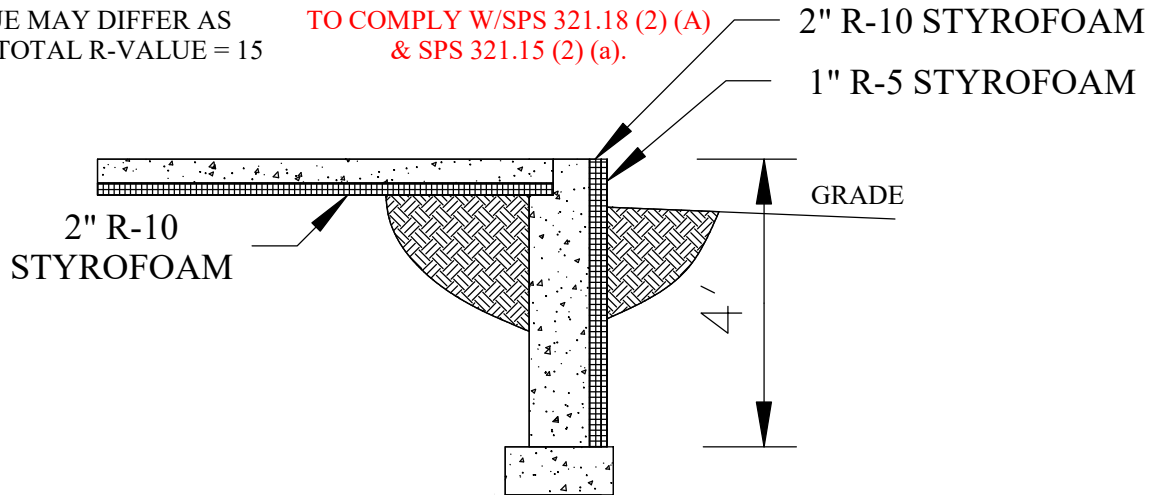

**EXAMPLE 9:
INSULATION BELOW SLAB & SLAB EDGE INSULATION
ON EXTERIOR OF FROST WALL & INTERIOR OF SLAB EDGE**

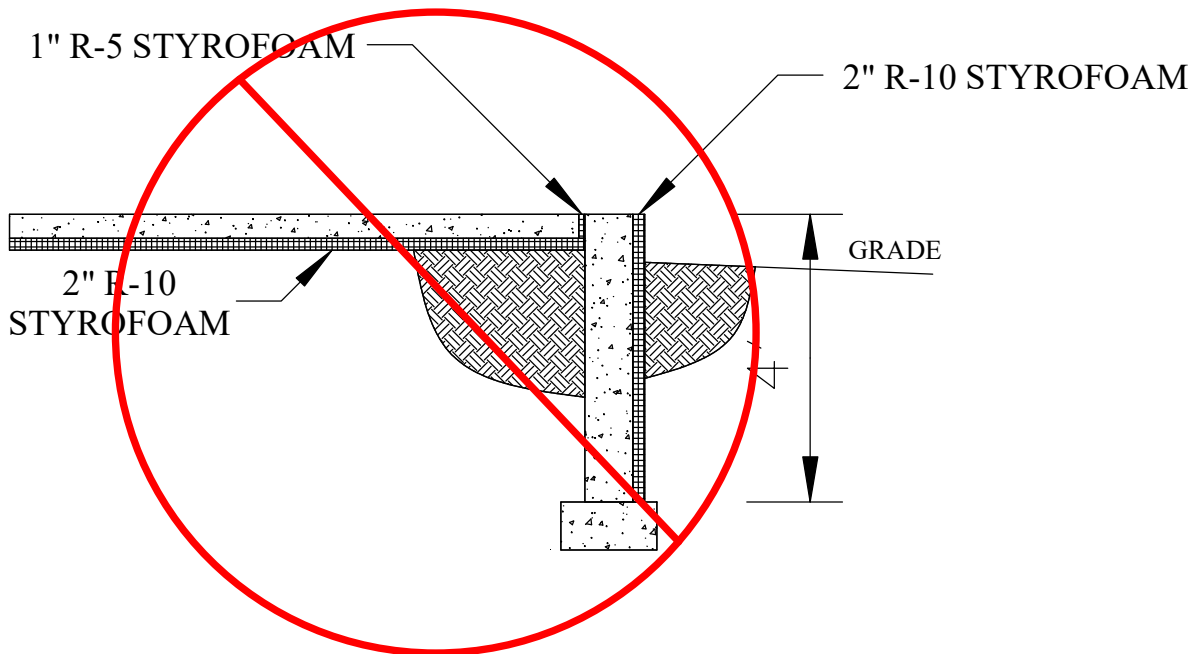

NON-COMPLIANT R-15 ONLY EXTENDS FROM THE TOP OF THE SLAB
TO THE BOTTOM OF THE INSULATION BENEATH THE SLAB FOR
A TOTAL OF 6" NOT THE REQUIRED 48"